



Test report

from

Warringtonfire Frankfurt GmbH

Foamalux Light, 3mm, white

by

BRETT MARTIN PLASTIC SHEETS

Test by DIN 4102-1: 1998

Reference: 2019-1552

Classification: B1

Test report No. 2019-1552
for applying of a required “Verwendbarkeitsnachweis”
issued 18.06.2019

Applicant: Brett Martin Ltd
24, Roughfort Road, Mallusk
Co. Antrim BT36 4RB
United Kingdom

Date of order: 07.05.2019
Date of sampling: *no official sampling of the specimen by a representative of Warringtonfire Frankfurt GmbH*
Date of arrival: 15.05.2019
Date of test: 29.05.2019

Order

Testing of the flammability (building class B1) according to DIN 4102-1 (May 1998)

Description / designation of the test object

Product name: Foamalux Light, 3 mm

Description of the relevant test procedure

DIN 4102 part 1 (Mai 1998)

This test report does not replace the required „Verwendbarkeitsnachweis“. It is only used for issuing the “Verwendbarkeitsnachweis”.

1. Description of the test material

1.1 Details of the customer:

Product name: Foamalux Light, 3 mm

Sample description:

main components: Foamalux Light is an extruded, closed cell, unplasticised PVC foam sheet

thickness: 3 mm

gross weight: 0.50 (kg/m³ [3 mm])

colour: white

Intended end use of product: signage, lamination, displays and printing substrate

1.2 By Warringtonfire Frankfurt GmbH determined values:

PVC foam

colour: white

thickness: 3 mm

Square weight: 1,435 kg/m²

Testing after storing 14- days under climatic conditions (23°C / 50 % rel. humidity).

2. Test results

2.1. Brandschachtprüfung according to DIN 4102-1

Sample A: Material tested in production direction.
 Sample B: Material tested cross to the production direction
 Sample C: Material tested in production direction.
 Sample D: Material tested in production direction.

Test results of the Brandschacht tests part 1						
line no.		Measurements test sample				
			A	B	C	D
1	<u>no. test arrangement according to DIN 4102 part 15, table 1</u>		1	1	1	1
2	<u>flame height max. over lower sample edge</u> time ¹⁾	cm	60	60	60	60
		min : s	00:39	00:39	00:50	00:53
3	<u>ascertainments on the front side</u> Flaming/glowing time ¹⁾	min : s	00:08	00:08	00:08	00:09
4	<u>melting / burning through</u> time ¹⁾	min : s	00:37	00:32	00:36	00:36
5	<u>ascertainments on the back side</u> Flaming/glowing time ¹⁾	min : s	no	no	no	no
6	discolouring time ¹⁾	min : s	no	no	no	no
7	<u>burning droplets</u> begin ¹⁾ extent	min : s	no	no	no	no
8	occasional dropping of material					
9	constant dropping of material					
10	<u>separating from burning sample parts</u> begin ¹⁾	min : s	no	no	no	no
11	occasional separating parts					
12	constant separating parts					
13	duration of burning on the sieve tray (max.)	min : s	no	no	no	no
14	influence on the burner flame by dropping of / separating material time ¹⁾	min : s	no	no	no	no
15	<u>earlier end of test</u> end of the fire scenario on the sample ¹⁾	min : s	no	no	no	no
16	time of a possible resulted test stop ¹⁾	min : s				
		min : s				

¹⁾ time from start of test

Test results of the Brandschacht tests part 2						
line no.		Measurements test sample				
		A	B	C	D	
17	<u>flaming after end of test</u> duration	min : s	no	no	no	no
18	number of sample		no	no	no	no
19	front side of sample	cm	no	no	no	no
20	backside of sample		no	no	no	no
21	flame length		no	no	no	no
22	<u>glowing after end of test</u> duration	min . s	--/--	--/--	--/--	--/--
23	number of sample		no	no	no	no
	place of occurrence		no	no	no	no
24	lower sample part		no	no	no	no
25	upper sample part		no	no	no	no
26	front side of sample		no	no	no	no
27	backside of sample		no	no	no	no
28	<u>smoke density</u> < 400 % x min		189	64	210	285
29	> 440 % x min		--/--	--/--	--/--	--/--
30	<u>diagram in annex no.</u>		1	2	3	4
31	<u>residual length</u> single results	cm	40 / 40 37 / 41	40 / 40 40 / 42	40 / 40 31 / 40	40 / 33 32 / 39
32	average of the single results	cm	39	40	37	36
33	photo of the sample on page		5	5	5	5
34	<u>smoke temperature</u> max. of the average results	°C	116	105	115	118
35	time ¹⁾	min : s	02:11	08:50	02:18	07:54
36	diagram in annex no.		1	2	3	5

¹⁾ time from start of test

Remarks: none

2.1.2 Appearance of the specimen after the test:

Sample A



Sample B



Sample C



Sample D



2.3 Normal flammability test according to DIN 4102-1

Test with edge ignition without deposit
Flame application on: lower sample edge
Edge ignition

Length direction

Sample-no.	1	2	3	4	5
Time from start of test					
Ignition point [s]	1	1	1	1	1
Reaching the measuring mark within 20 seconds	no	no	no	no	no
Self-extinguishing of the flame [s]	15	15	15	15	15
Max. flame height [mm]	40	40	40	40	40
Time [s]	10	10	10	10	10
End of afterflaming [s]	-	-	-	-	-
End of afterglowing [s]	-	-	-	-	-
Flames extinguished after [s]	-	-	-	-	-
Smoke development (visual impression) _{low / moderate / strong}	strong smoke development				
Separating from burning material	no	no	no	no	no
Time [s]	-	-	-	-	-

Remarks: none

Cross direction

Sample-no.	1	2	3	4	5
Time from start of test					
Ignition point [s]	1	1	1	1	1
Reaching the measuring mark within 20 seconds	no	no	no	no	no
Self-extinguishing of the flame [s]	15	15	15	15	15
Max. flame height [mm]	30	30	30	30	30
Time [s]	10	10	10	10	10
End of afterflaming [s]	-	-	-	-	-
End of afterglowing [s]	-	-	-	-	-
Flames extinguished after [s]	-	-	-	-	-
Smoke development (visual impression) _{low / moderate / strong}	strong smoke development				
Separating from burning material	no	no	no	no	no
Time [s]	-	-	-	-	-

3. **Appearance of the sample after the small burner test:**



Assessment

The material described in chapter one fulfils the requirements of the building class B2 according to DIN 4102-1 (Mai 1998).

The determined test results show that the material also fulfils the requirements

of the building class B1

according to DIN 4102-1 (Mai 1998).

Special note

The fire test result is only valid for the material described in chapter one in the tested colour, thickness and square weight.

The test was carried out in free hanging configuration.

The distance to other plane material must be more or equal then 40 mm.

The material wasn't tested after an outside storage.

In combination with other materials (for example coatings, deposits) the burning behaviour could be influenced unfavourable so that the classification above is not valid any longer. According to DIN 4102-1 the burning behaviour in combination with other materials has to be tested separately.

This test report does not replace the required „Verwendbarkeitsnachweis“. It is only used for issuing the “Verwendbarkeitsnachweis”.

Frankfurt, the 18th June 2019



H. Anders
Tester in Charge



P. Scheinkönig
Prüfstellenleiter Bau-PVO



This Test report is valid until 28.05.2024.

The results of the tests relate only to the behaviour of the test specimen which is designated on the top.



Test reports are only allowed to be published or reproduced, not changed in form and tenor without permission of the Warringtonfire Frankfurt GmbH. The abridged account of a test report is only allowed with the agreement of the Warringtonfire Frankfurt GmbH.

This test report is a translation of the German version 2019-1552 (issued 18.06.2019). In case of doubt only the German version is valid

This test report contains 8 pages and 4 annexes.


Annex 1 to the Test report No. 2019-1551 issued 18.06.2019

Sample A:

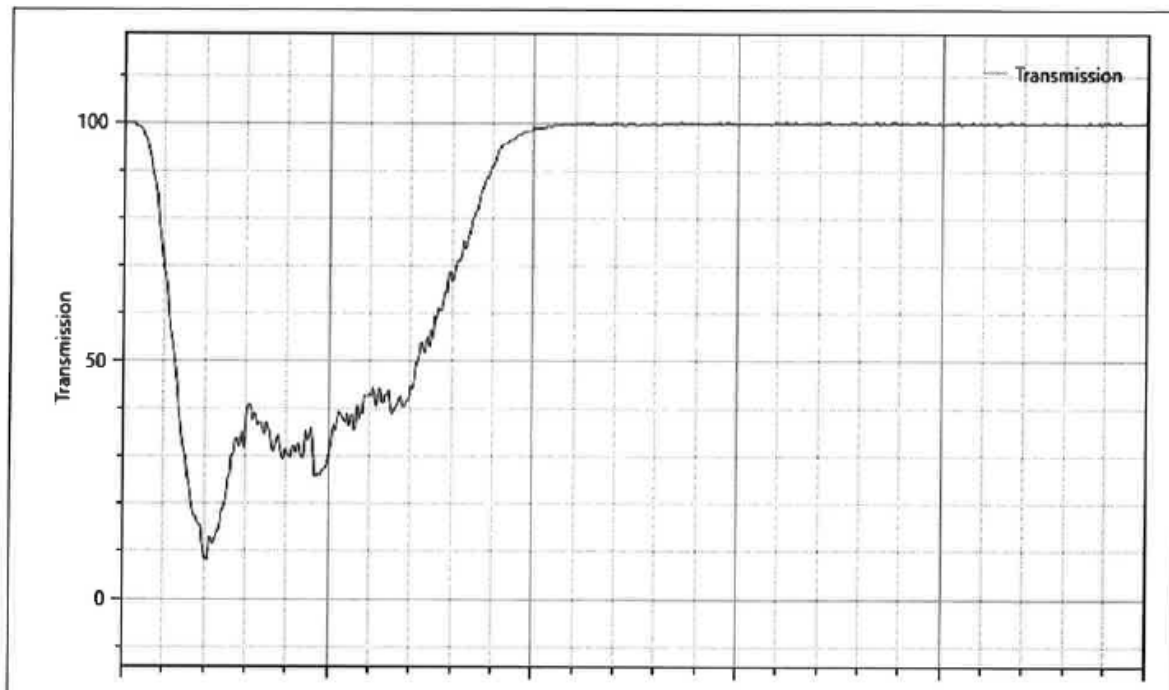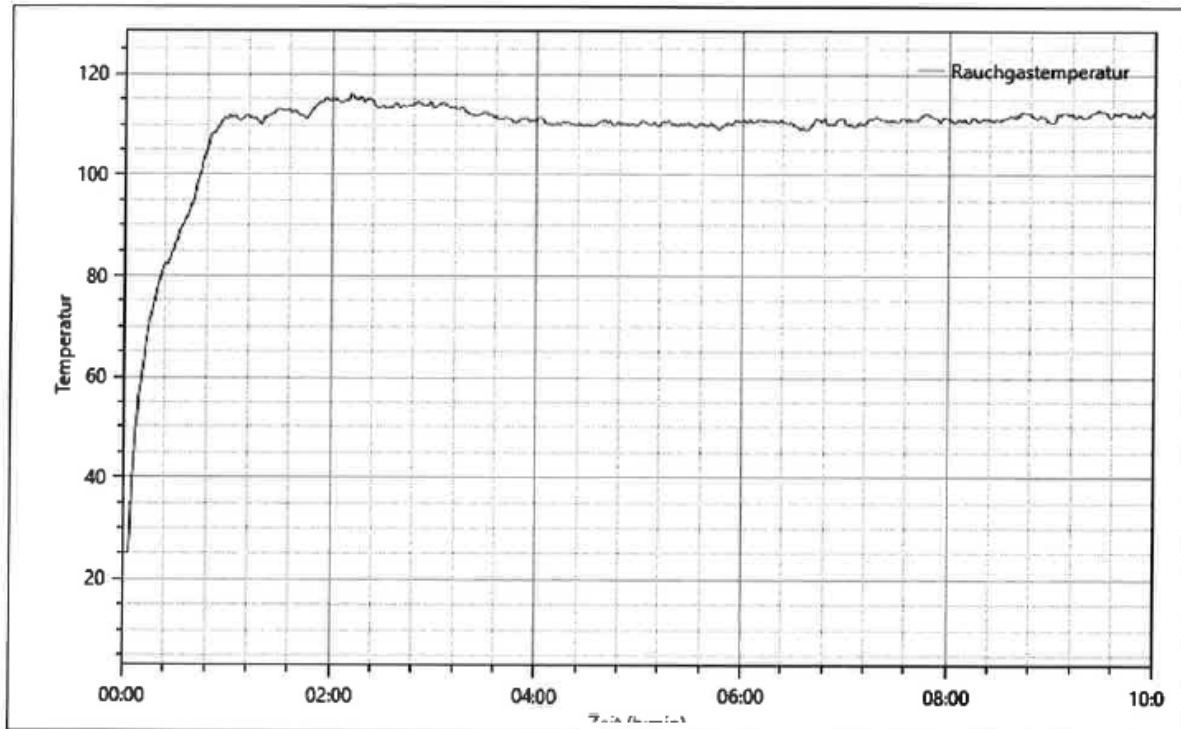



Annex 2 to the Test report No. 2019-1551 issued 18.06.2019

Sample B:

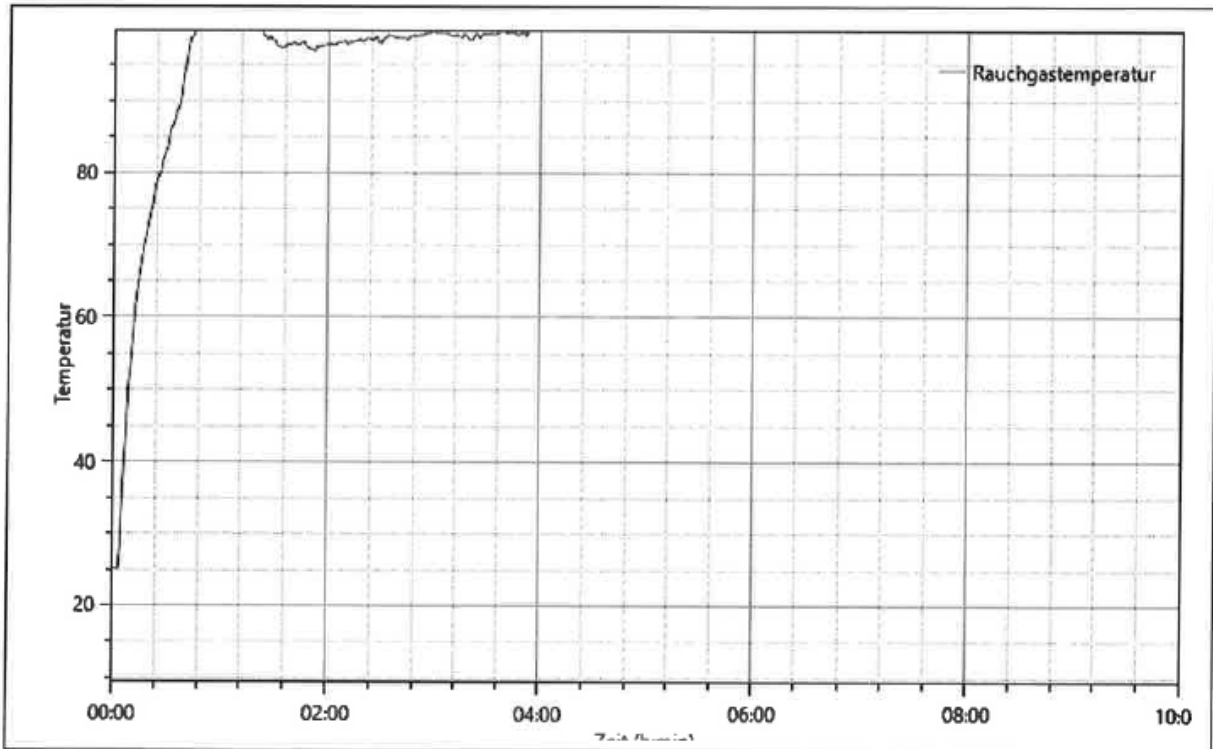

Annex 3 to the Test report No. 2019-1551 issued 18.06.2019

Sample C:

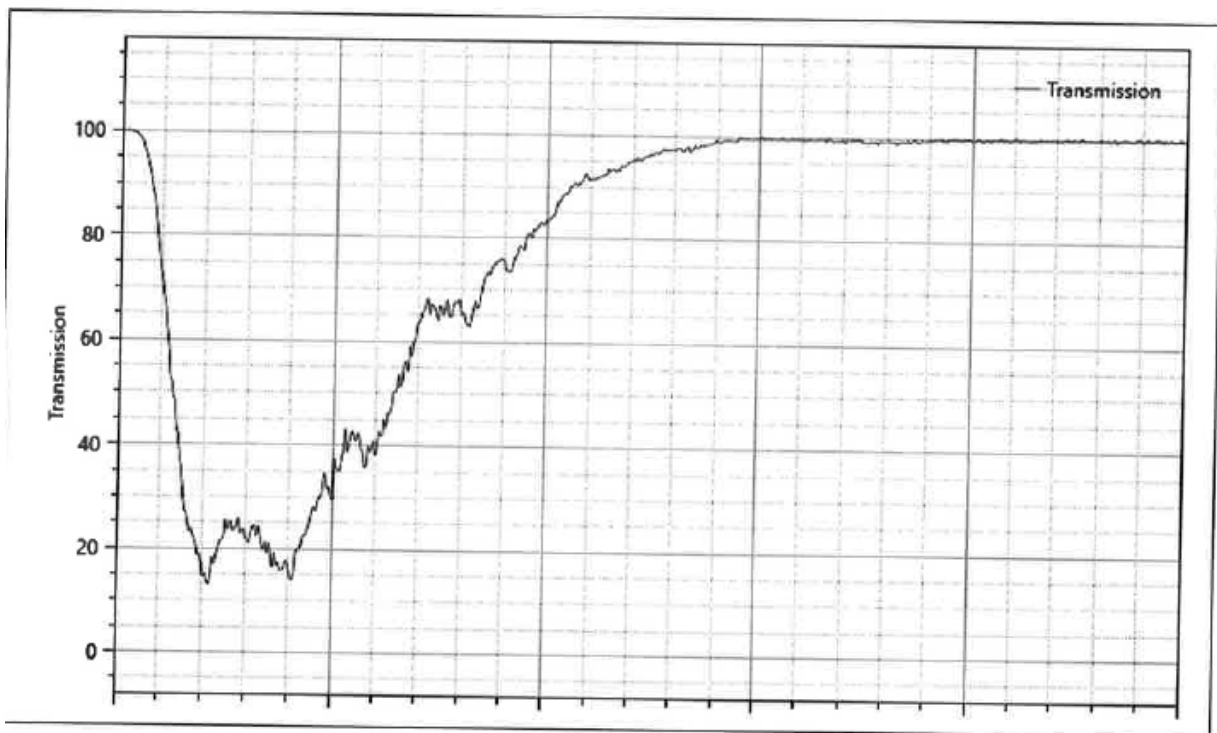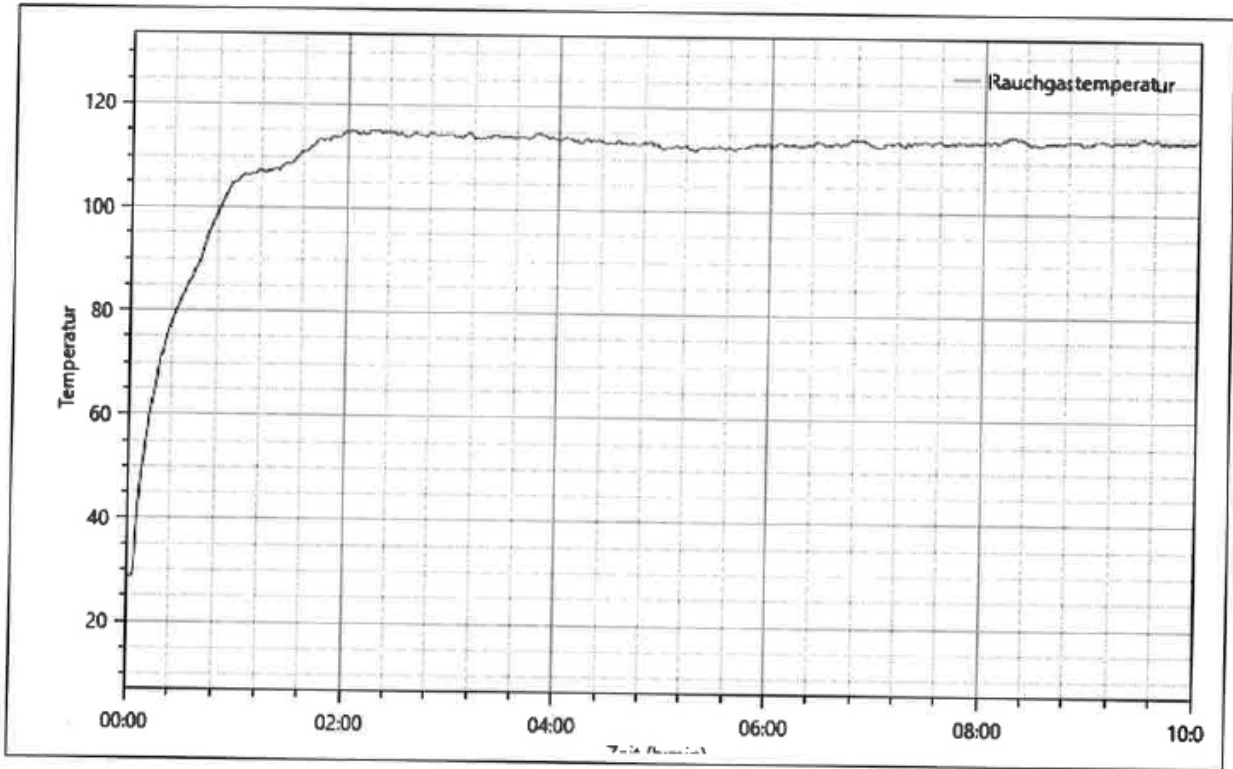

Annex 4 to the Test report No. 2019-1551 issued 18.06.2019

Sample D:

